

Our Ref: 23765205 DNS/3260565 - FOR NATIONAL GRID PURPOSE ONLY

Wednesday, 03 November 2021

Lisa Goodwin
National Grid House Warwick Technology Park Gallows Hill

Warwickshire
CV34 6DA

National Grid House
Warwick Technology Park
Gallows Hill, Warwick
CV34 6DA

Electricity Emergency Number:
0800 40 40 90*
*Available 24 hours, 7 days/week.
Calls may be recorded and monitored.
www.nationalgrid.com

Asset Protection
Gas Transmission
National Grid

National Grid Electricity – No Assets Affected


Dear Sir/ Madam,

An assessment has been carried out with respect to National Grid Electricity Transmission plc's apparatus and the proposed work location. Based on the location entered into the system for assessment the area has been found to not affect any National Grid Electricity Transmission plc's apparatus.

Please note this response and any attached map(s) are valid for 28 days

Yours sincerely

Asset Protection Team

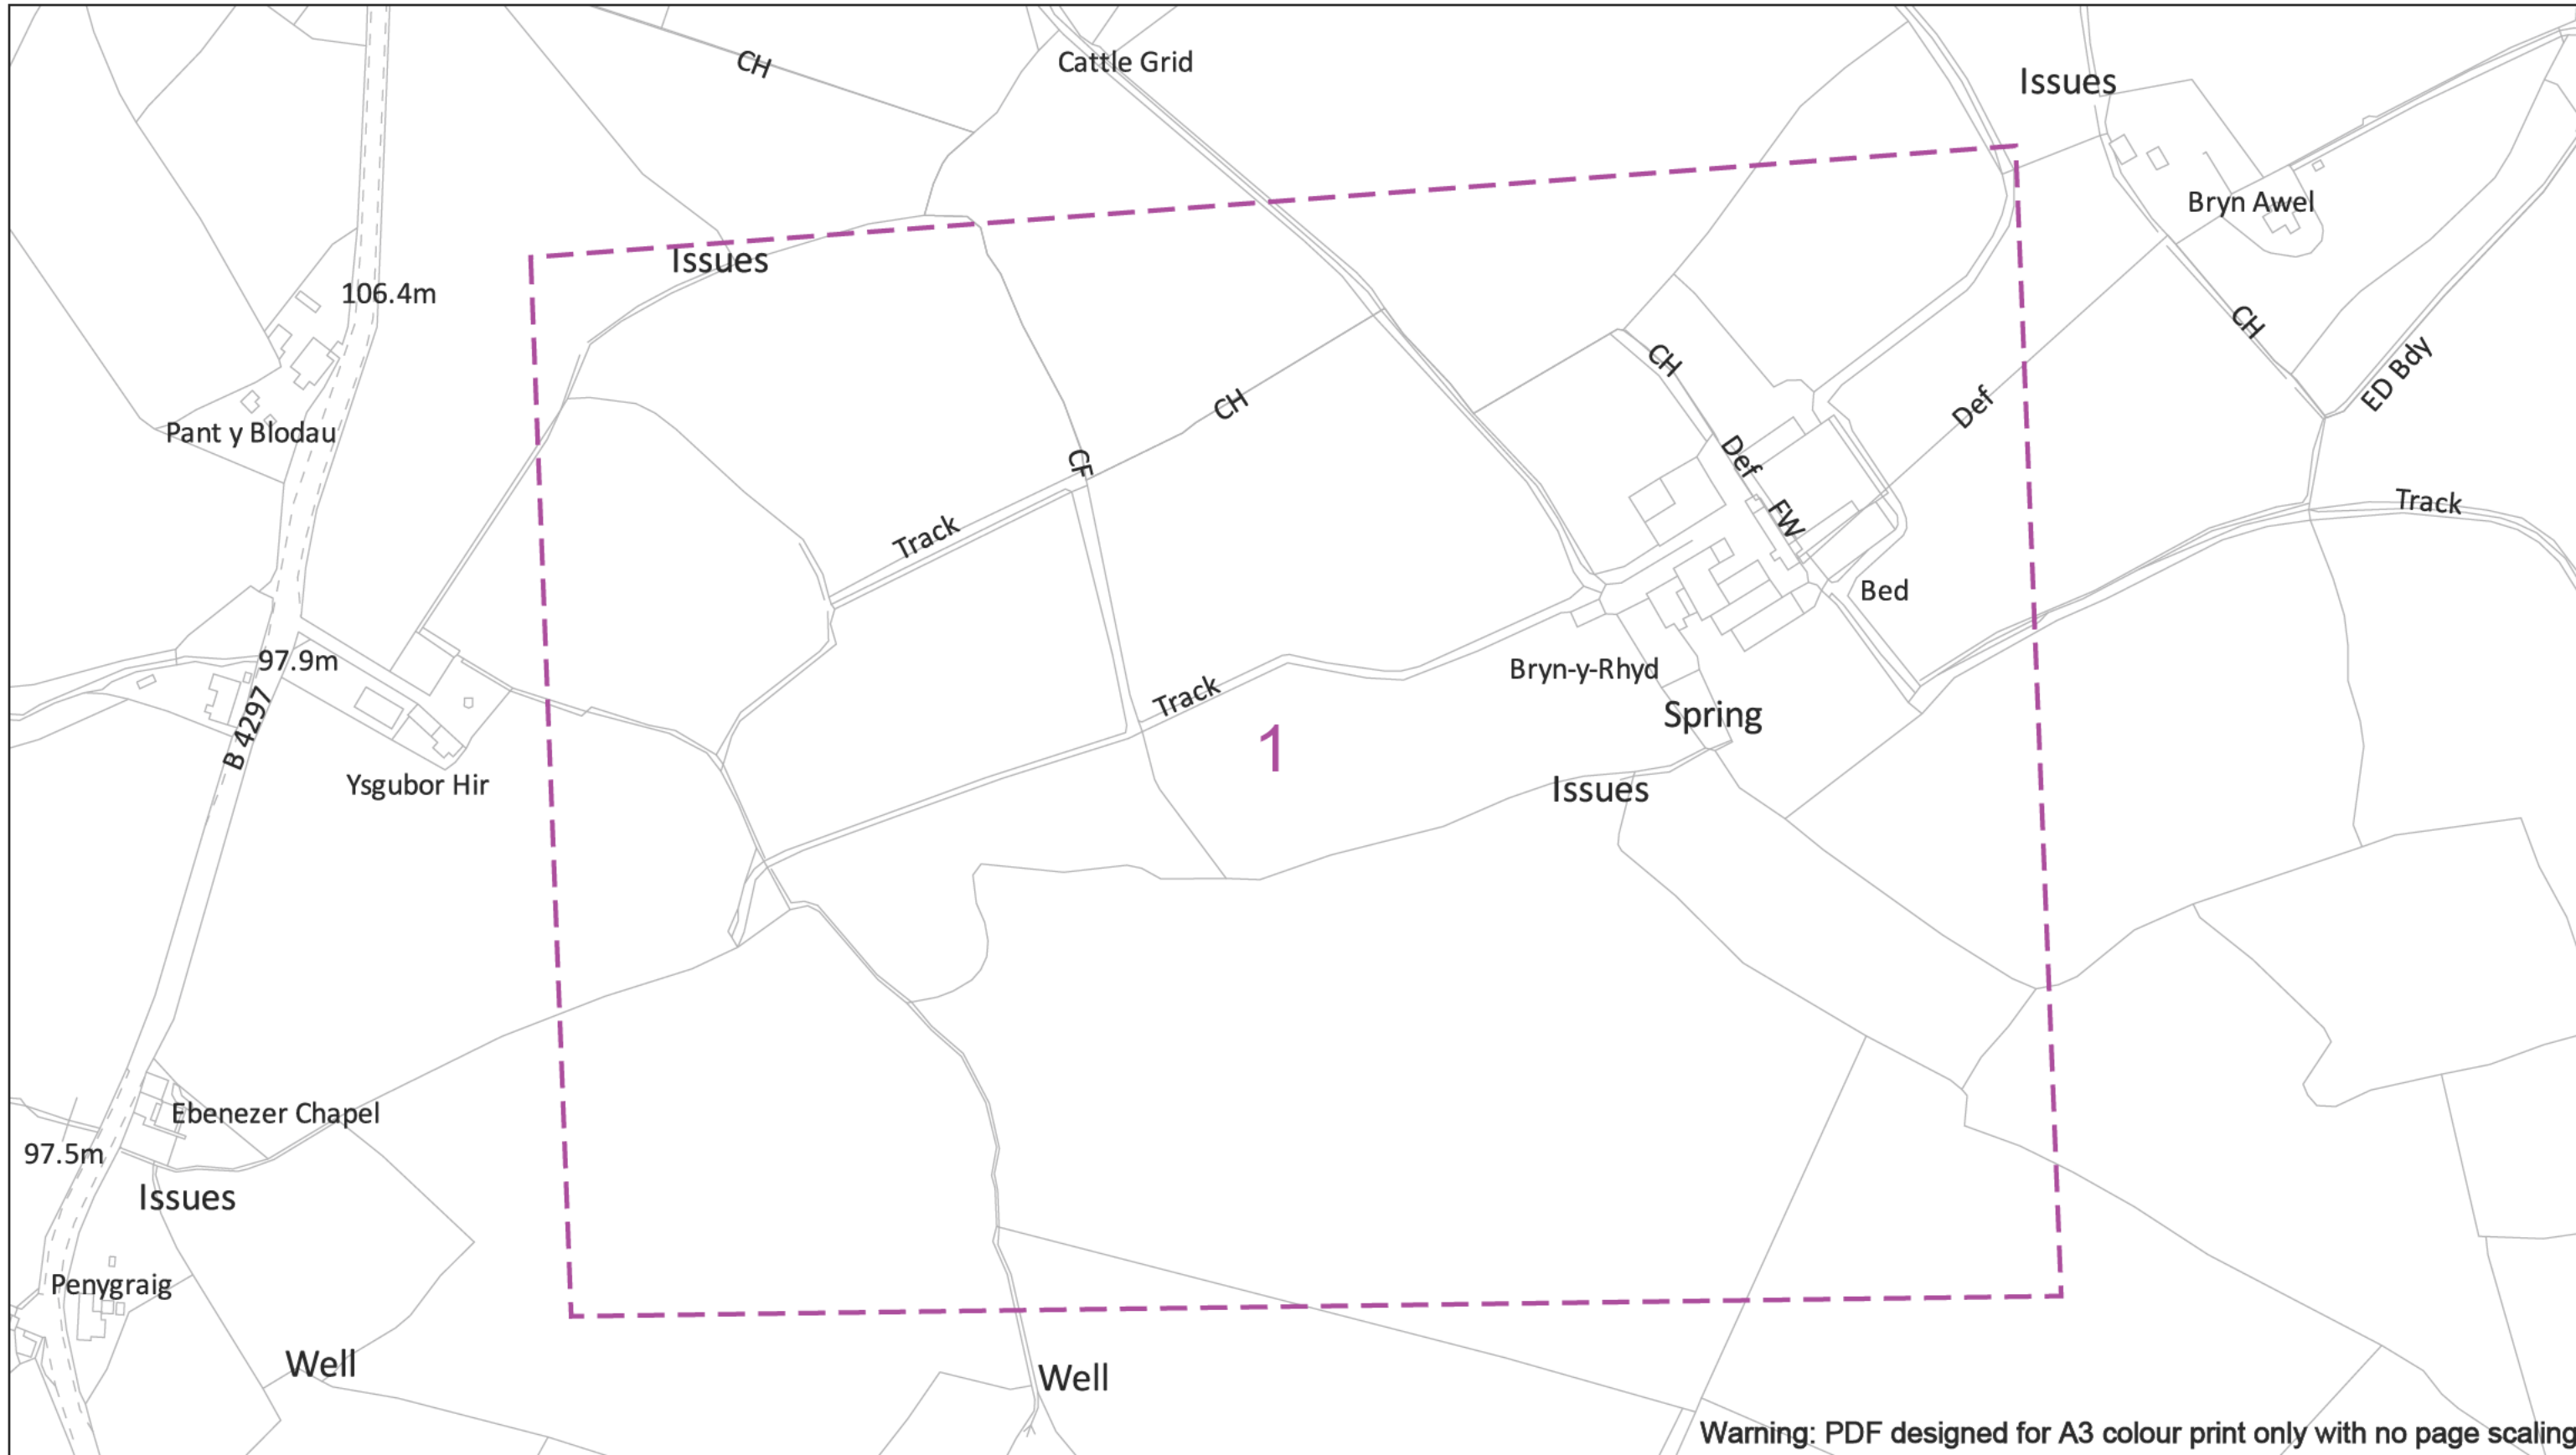

Warning: PDF designed for A3 colour print only with no page scaling

EXTREME CAUTION - HIGH VOLTAGE
****RISK OF DEATH OR SERIOUS INJURY****

Date Requested: 03/11/2021
 Job Reference: 23765205
 Site Location: 258917 208014
 Requested by:
 Miss Lisa Goodwin
 Your Scheme/Reference:
 DNS/3260565 - FOR NATIONAL
 GRID PURPOSE ONLY

Scale: 1:2500 (When plotted at A3)

IMPORTANT NOTICES
 This plan shows those pipes owned by National Grid Electricity Transmission plc in its role as a Licensed Electricity Transporter (ET). Electricity cables owned by other ETs, or otherwise privately owned, may be present in this area. Information with regards to such cables should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Ancillary equipment such as cooling systems and communication cables are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by National Grid Electricity Transmission plc or their agents, servants or contractors for any error or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of cables and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near electricity apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

National Grid Electricity Emergency Number: 0800 40 40 90
 Available 24 hours, 7 days/week. Calls may be recorded and monitored

Warning: PDF designed for colour print only with no page scaling



- Dig Sites**
- Area:** **Line:**
- Underground Cables**
- Overhead Lines**
- Fibre Cables**

nationalgrid

NationalGrid House
 Warwick Technology Park
 Gallows Hill
 Warwick
 CV34 6DA

ENQUIRY SUMMARY

Received Date

03/11/2021 11:43

Work Start Date

02/12/2021

Your Reference

DNS/3260565 - FOR NATIONAL GRID PURPOSE ONLY

Location

Centre Point: 258917 208014

X Extent:

Y Extent:

Postcode: SA4 0FD

Map Options

Paper Size: A3

Orientation: LANDSCAPE

Scale: 1:2500

Real World Extents: 604m x 462m

Enquirer Details

Organisation Name: National Grid

Contact Name: Lisa Goodwin

Email Address: [REDACTED]

Address: National Grid House Warwick Technology Park Gallows Hill, , Warwickshire, CV34 6DA

Enquiry Type

Initial Enquiry

Activity Type

Planning Applications

Work Types

Solar Farm

Notes/Works Description (if supplied)

Solar Farm - BRYN-Y-RHYD FARM, LLANEDI, PONTARDULAIS, WALES, SA4 0FD